





National Combustion Co., Inc.  
104-11 180th Street  
Jamaica, NY 11433  
Ph: 718-291-8400  
Fx: 718-291-6870

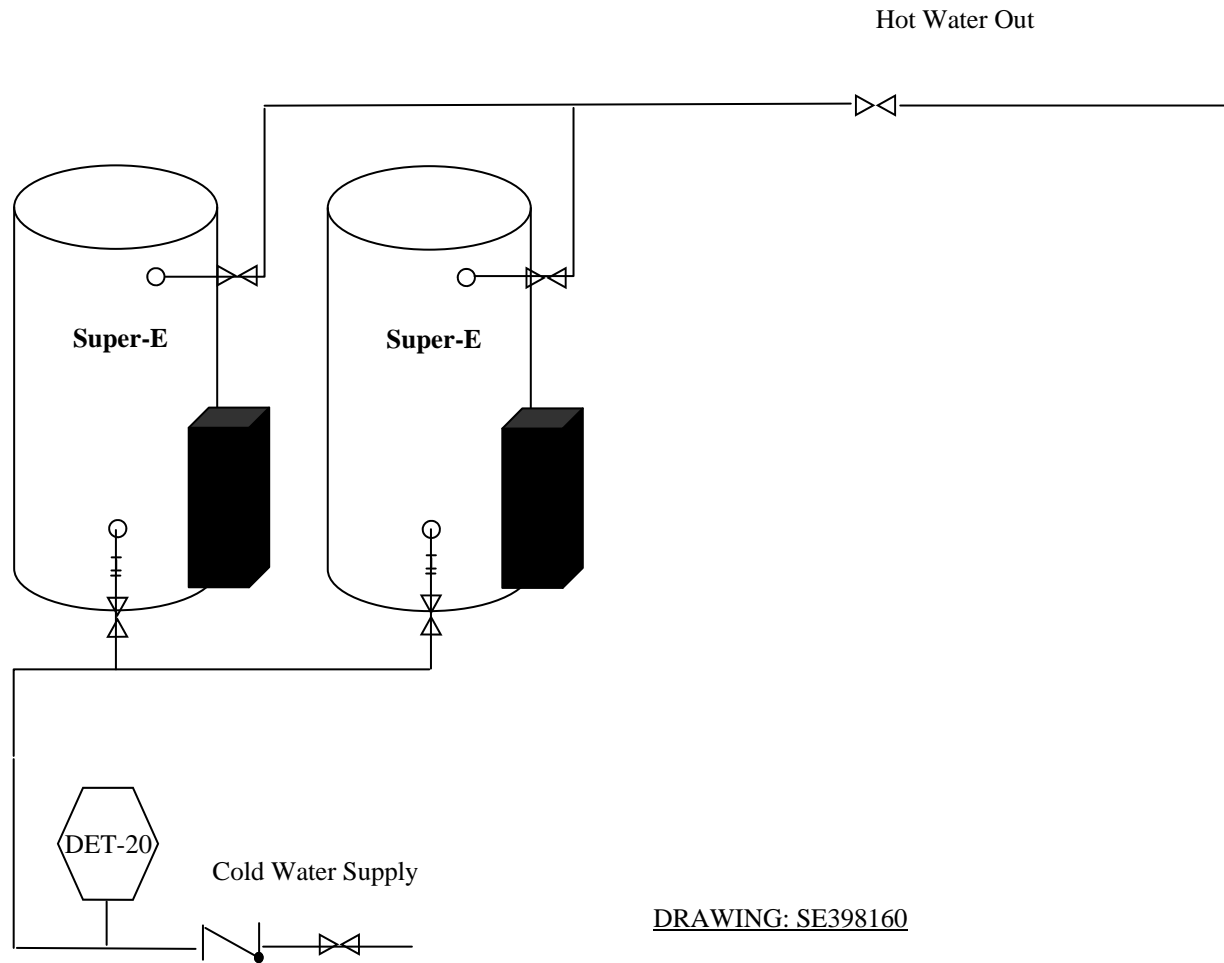

DRAWING: SE398160

### 2 80 or 119 Gallon Super-E's w/o recirculation line

Notes:

1. This drawing shows suggested piping configuration. Check local codes and ordinances for additional requirements.
2. Minimum 1-1/2" pipe size throughout is recommended.
3. Back flow preventer may be required. Check local codes.
4. Thermal expansion tank is required. NATCO suggests using 1 Watts DET-20 expansion tanks.
5. Additional ball-valves, drain valves, and unions may be used for ease of maintenance.